



장 비 일 램 표

■ LG 시스템에어컨 실내기																													
장비번호	분류	모델명	수량 (대)	정격냉방능력 (W)	정격난방능력 (W)	전원 (상, 선식, V, Hz)	정격소비전력 (kW)		운전전류 (A)		송풍기			제품중량 (kg)	접속구경(mm)			본체치수(mm)		팬넨지수(mm)		통신선(mm²)		전원선(mm²)		누전차단기		비고	
							냉방	난방	냉방	난방	풍량(CMM)	기외정압(mmAq)	정격출력(W)		액관	가스관	드레인관	W x H x D	W x H x D	VCTF-SB	H07RN-F	규격	수량						
IAC-32C	1WAY 카세트	R-W0320C2S	1	3,200	3,600	1, 2, 220, 60	0.02	0.02	0.09	0.09	10.0	-	30	12.3	6.35	12.7	32	860 x 132 x 450	1,160 x 34 x 500	0.75 ~ 1.5	2.5								
IAC-52T	4WAY 카세트 듀얼배인	R-W0520A2U	1	5,200	5,900	1, 2, 220, 60	0.025	0.025	0.25	0.25	16 / 14 / 13	-	51	21.0	9.52	15.88	32	840 x 204 x 840	950 x 35 x 950	0.75 ~ 1.5	2.5								
IAC-60T		R-W0600A2U	1	6,000	6,800	1, 2, 220, 60	0.03	0.03	0.28	0.28	17 / 15 / 14	-	51	21.0	9.52	15.88	32	840 x 204 x 840	950 x 35 x 950	0.75 ~ 1.5	2.5								
IAC-72T		R-W0720A2U	9	7,200	8,100	1, 2, 220, 60	0.047	0.047	0.44	0.44	25 / 23 / 21	-	135	26.0	9.52	15.88	32	840 x 288 x 840	950 x 35 x 950	0.75 ~ 1.5	2.5								
IAC-83T		R-W0830A2U	4	8,300	9,300	1, 2, 220, 60	0.053	0.053	0.48	0.48	26 / 24 / 21	-	135	26.0	9.52	15.88	32	840 x 288 x 840	950 x 35 x 950	0.75 ~ 1.5	2.5								
IAC-100T		R-W1000A2U	1	10,000	11,200	1, 2, 220, 60	0.069	0.069	0.62	0.62	28 / 24 / 21	-	135	26.0	9.52	15.88	32	840 x 288 x 840	950 x 35 x 950	0.75 ~ 1.5	2.5								
합 계			17																										

* 수량을 제외한 소비전력등의 제품사양은 한대기준임. *4Way 일반형 제품은 인공지능(공기청정,인체감지), 연동 및 습도센서 적용 가능.

■ LG 시스템에어컨 실외기 (SUPREME)																														
장비번호	분류	모델명	수량 (대)	냉방능력			전원 (상, 선식, V, Hz)	냉난방 효율 (EERa)	소 비 효 율 등급	소비전력(kW)					운전전류 최대 (A)	형식	송풍기		냉매	제품중량 (kg)	배관경		본체치수		연결전선 (mm²)		누전차단기		비고	
				정격	정격	-15°C (W)				냉방	난방	난방저온	최대	풍량 (CMM)			정격출력 (kW)	액관			가스관	W x H x D (mm)	전원선	통신선	규격	수량				
OAC-42	냉난방 절환형	RP-W42GX9E	1	121,800	137,100	118,200	3, 4, 380, 60	-	-	34.0	8.6	33.1	43.9	59.0	92.4	프로펠러식	320x1 +220x2	0.9x2 +1.2x2	R410A	297x1+210x2	19.05	41.3	(1,240x1,745x760) x 1 + (930x1,745x760) x 2	50.0	0.75~1.5	125				
합 계			1																											

* 수량을 제외한 소비전력등의 제품사양은 한대기준임.

△					
△					
REV.	DATE	DESCRIPTION	BY	BY	APP

ISSUES & REVISIONS

PROJECT TITLE


DRAWING TITLE

DRAWN	SCALE
CHECK	
APPR	
DATE	

SHEET NO.

DRAWING NO.

총무로 영상센터 본관

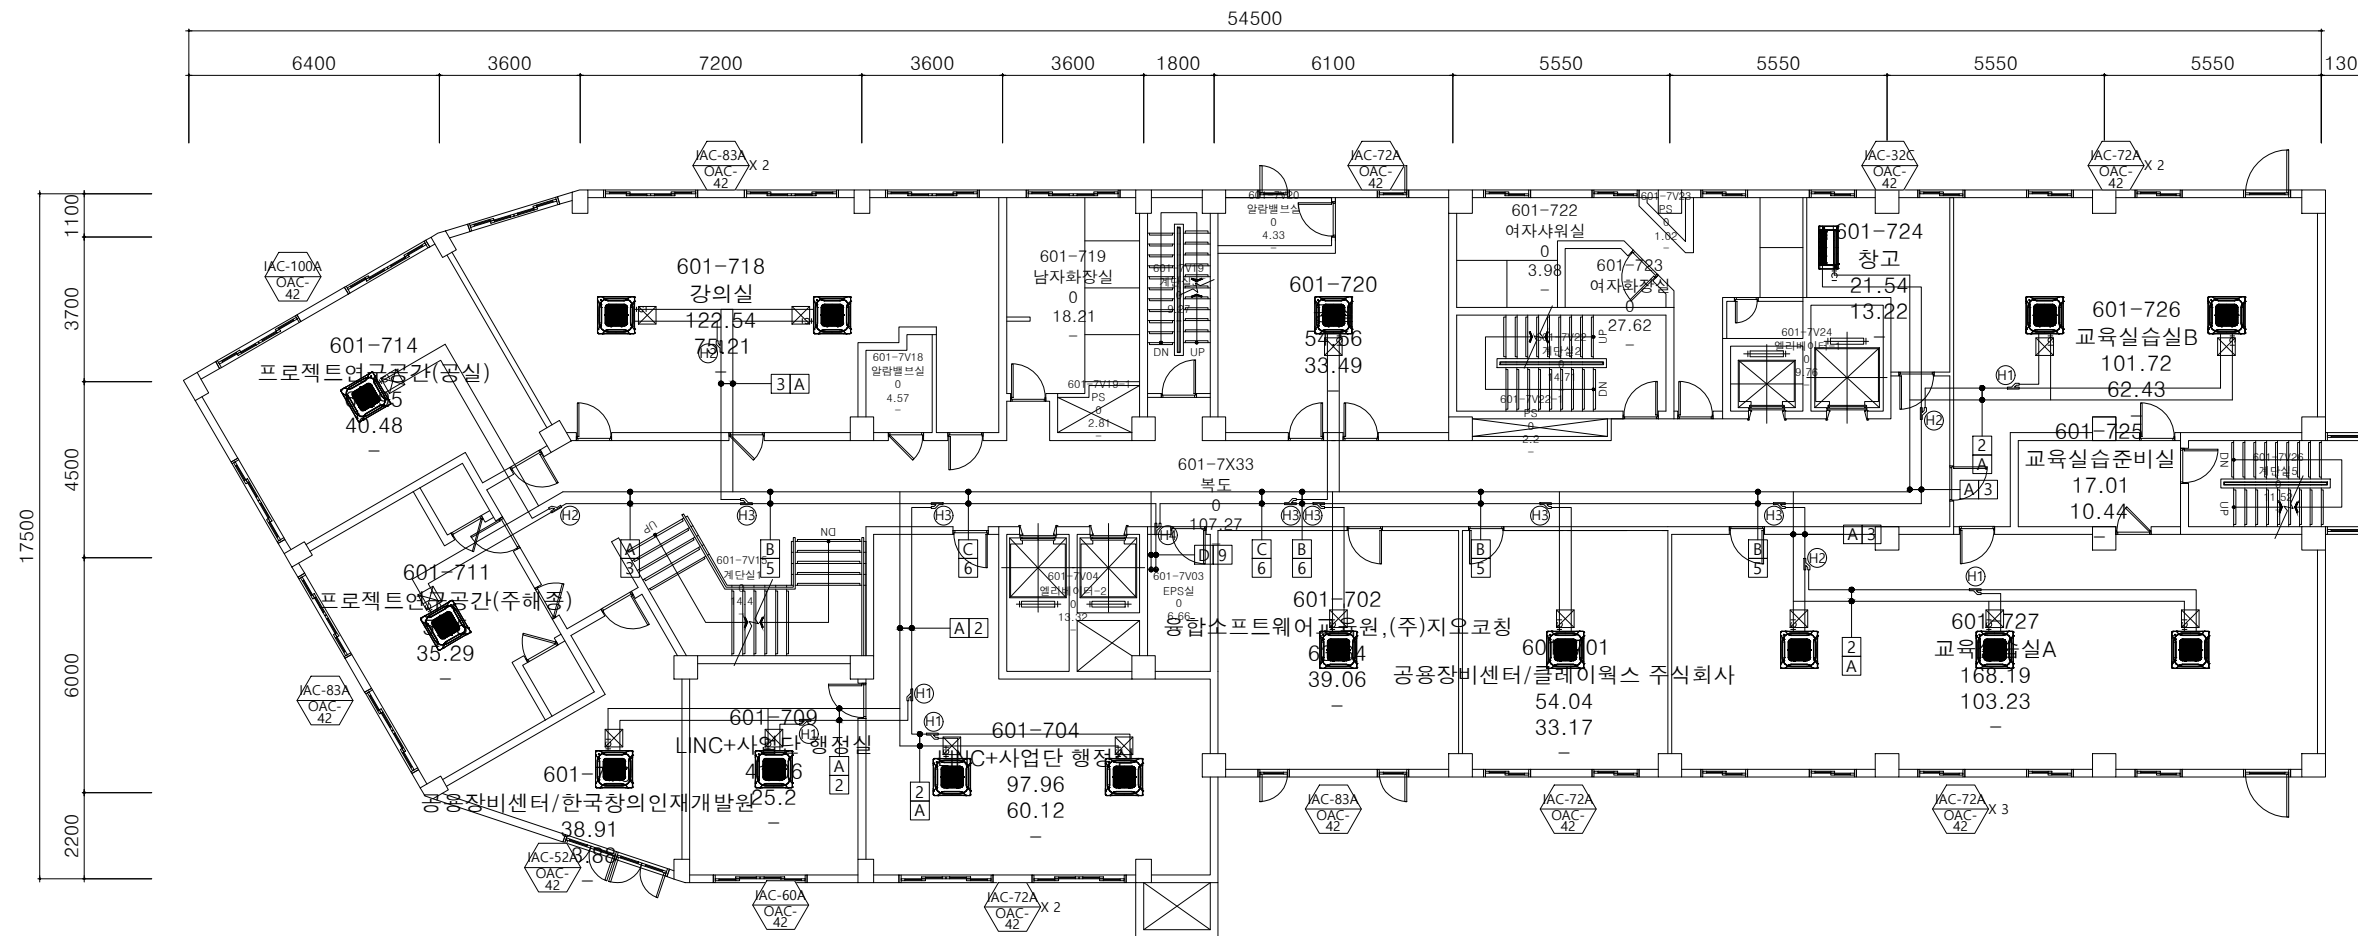

지상 7층 평면도

PROJECT TITLE	
INTERIOR DESIGN	
DAOL A&C / Keoseong Design 75, Ahasan-ro 78-gil, Gwangjin-gu, Seoul, Republic of Korea t +82 02 472 0337 f +82 02 483 6033 www.keoseong.co.kr	
KEY PLAN	
NOTE	
APPROVED BY	
CHECKED BY	
DRAWING BY	
DATE	2022. 8
SCALE	A1 : A3 :
DRAWING TITLE	총무로 영상센터 지상 7층 냉난방 배관 평면도
DRAWING NO	□ A - □ □ □ □ 1
SHEET NO	□ □ - □ □ □ □ 1

SCALE
A3 : 1/200